





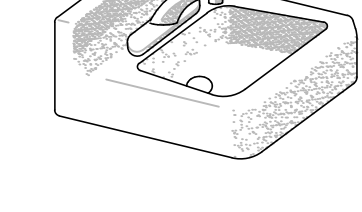
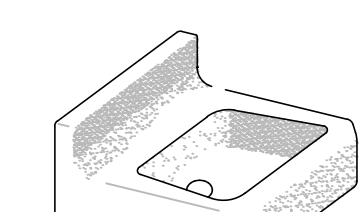
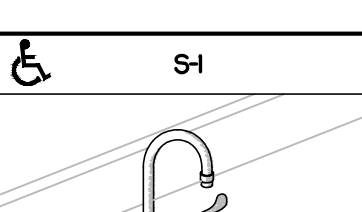
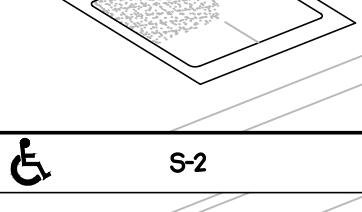
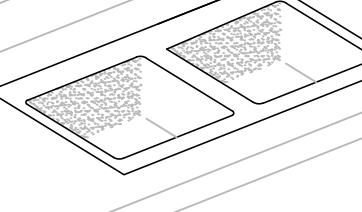
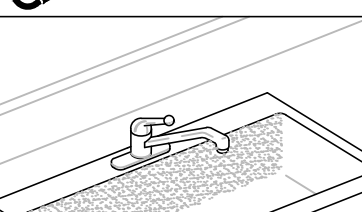
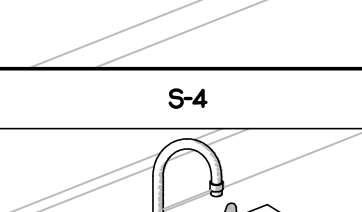
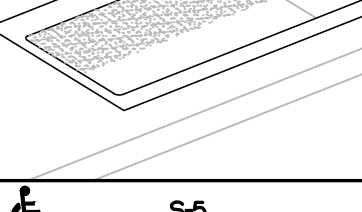

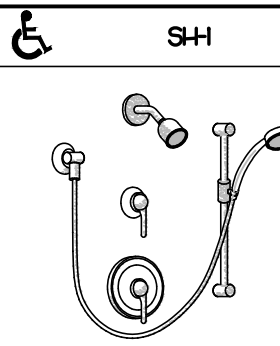
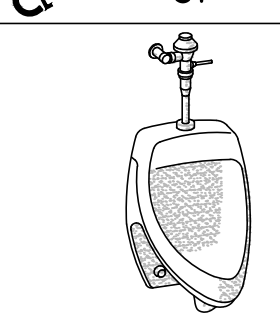


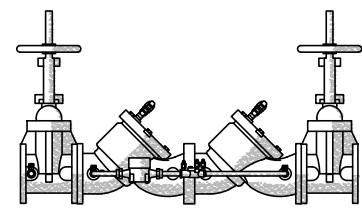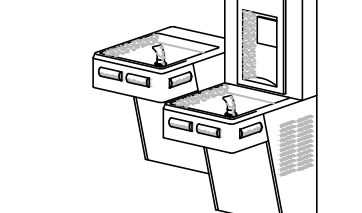


PLUMBING FIXTURE SCHEDULE										
SYMBOL / IMAGE	DESCRIPTION	3 - EQUALS					PIPING CONNECTIONS			
		MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	COLD WATER	HOT WATER	SANITARY SEWER
	BACKFLOW PREVENTOR LEAD FREE, REDUCED PRESSURE ZONE WITH GATE VALVES AND STRAINER, MOUNT 24" ABOVE FINISHED FLOOR.	WATTS	LF009-LF	WILKINS		FEBCO		3"	-	-
	CO-1 WALL CLEANOUT ACCESS COVER PVC CLEANOUT BODY AND PLUG TO BE GAS AND WATER TIGHT, PLUG TO HAVE A BRASS THREADED INSERT TO RECEIVE SECURING SCREW FOR STAINLESS STEEL ROUND ACCESS COVER.	ZURN	CO-24S-PVC	MFAB		JR SMITH		-	-	SEE PLUMB DRAWINGS
	CO-2 FLOOR CLEANOUT PVC CLEANOUT WITH AND ADJUSTABLE PVC RISER, NICKEL BRONZE FRAME AND COVER, AND AN ABS TAPER THREADED PLUG. CLEANOUT TO BE GAS AND WATERTIGHT.	ZURN	CO2449	MFAB		JR SMITH		-	-	SEE PLUMB DRAWINGS
	EW-1 WATER COOLER PROVIDE WITH FRONT AND SIDE CONTROLS, SHUT-OFF VALVE, CARRIER, AND TRAP. PROVIDE STAINLESS STEEL FINISH. PROVIDE WITH BOTTLE FILLER.	OASIS	P88PFL	ELKAY	LZ5TLBWS	HALSEY TAYLOR	JH-BHACBUP-WF	1/2"	-	2"
	EW-1 EYEWASH MIXING VALVE STAINLESS STEEL EYEWASH RECEPTOR WITH TWIN HEADS AND CAPS. EYEWASH IS TO MEET STANDARDS SET FORTH BY ANSI Z358.1 PROVIDE WITH P-TRAP AND WITH TEPID WATER THROUGH A MIXING VALVE.	BRADLEY	S9-224TPT	SPEAKMAN	SE-582	GUARDIAN	G750	1/2"	1/2"	2"
	EW-2 Faucet Mounted Eyewash MIXING VALVE STAINLESS STEEL FAUCET MOUNTED EYEWASH RECEPTOR WITH TWIN SOFT-FLOW HEADS AND CAPS. EYEWASH IS TO MEET STANDARDS SET FORTH BY ANSI Z358.1-1998.	BRADLEY	S9-200B	GUARDIAN		ACORN		1/2"	1/2"	2"
	L-1 LAVATORY Faucet TRAP SUPPLY WALL HUNG LAVATORY SHALL BE MADE OF CAST IRON WITH A WHITE FINISH HAVE 4" CENTERS, AN OVERFLOW, SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT, DECK MOUNTED, BATTERY OPERATED FAUCET SHALL BE CHROME FINISH 4" CENTERS, WITH 3/8" COPPER SUPPLY TUBE INLETS, AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS, FULL TURN BRASS STEM REDUCER, AND FLANGE. INLET SHALL BE 3/8" IPS. OUTLET SHALL BE 3/8" IPS. P-TRAP SHALL BE CHROME PLATED CAST BRASS BODY WITH CLEANOUT, CAST BRASS ELBOW AND CAST BRASS SLIP NUT, AND FLANGE. PROVIDE WITH OFFSET DRAIN AND TRUEBRO LAV SHIELD. PROVIDE FAUCET WITH COVER PLATE AND WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 OR CSA B253.	KOHLER	K-286-O	AMERICAN STANDARD	C35502	ZURN	Z5834			
	L-2 LAVATORY Faucet TRAP SUPPLY WALL HUNG LAVATORY SHALL BE MADE OF CAST IRON WITH A WHITE FINISH HAVE 4" CENTERS, AN OVERFLOW, SEE ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT, DECK MOUNTED FAUCET SHALL BE CHROME FINISH 4" CENTERS, WITH 3/8" COPPER SUPPLY TUBE INLETS, AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS, FULL TURN BRASS STEM REDUCER, AND FLANGE. INLET SHALL BE 3/8" IPS. OUTLET SHALL BE 3/8" IPS. P-TRAP SHALL BE CHROME PLATED CAST BRASS BODY WITH CLEANOUT, CAST BRASS ELBOW AND CAST BRASS SLIP NUT, AND FLANGE. PROVIDE WITH OFFSET DRAIN AND TRUEBRO LAV SHIELD. PROVIDE FAUCET WITH COVER PLATE AND WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 OR CSA B253.	KOHLER	K-286-O	AMERICAN STANDARD	C35502	ZURN	Z5834			
	S-1 SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED GOOSENECK FAUCET SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROMWRAP INSULATOR.	JUST	SL-ADA-155-A-GR	ELKAY	ELR560					
	S-2 2-COMPARTMENT SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED FAUCET WITH SPRAYER SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROVIDE WITH PROMWRAP INSULATOR.	JUST	DLX-2233-A-J	ELKAY				1/2"	1/2"	
	S-3 1-COMPARTMENT SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED FAUCET SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROVIDE WITH PROMWRAP INSULATOR.	JUST	SL-ADA-283-65-J	ELKAY				1/2"	1/2"	
	S-4 1-COMPARTMENT SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED FAUCET SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROVIDE WITH PROMWRAP INSULATOR.	ELKAY	DLR27220	JUST						
	S-5 1-COMPARTMENT SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED FAUCET SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROVIDE WITH PROMWRAP INSULATOR.	JUST	SL-ADA-283-65-J	ELKAY				1/2"	1/2"	
	S-6 SINK Faucet TRAP SUPPLY STRAINER SINK IS TO BE 18 GAUGE STAINLESS STEEL, SELF-RIMMING, DECK MOUNTED GOOSENECK FAUCET SHALL BE CHROME FINISHED, WITH 1/2" INLET AND PROVIDED WITH AN AERATOR. RIGID SUPPLY KIT SHALL INCLUDE CHROME PLATED BRASS STOPS WITH THREADED CONNECTIONS AND FLANGE. INLET AND OUTLET SHALL BE 3/8" IPS. PROVIDE WITH PROVIDE WITH PROMWRAP INSULATOR.	JUST	SL-ADA-152-A-GR	ELKAY	LRAD-229			1/2"	1/2"	
	SA-1 SHOCK ABSORBER SHOCK ABSORBERS SHALL HAVE A STAINLESS STEEL CASING, FLEXIBLE MECHANICAL BELLOW, PRESSURIZED INERT GAS CHAMBER AND CERTIFICATION STAMP AS CONFORMING TO STANDARD PDI VH-201 OF THE PLUMBING AND DRAINAGE INSTITUTE.	JOSAM	75000	ZURN	Z700	WADE	4480			

PLUMBING FIXTURE SCHEDULE										
SYMBOL / IMAGE	DESCRIPTION	3 - EQUALS					PIPING CONNECTIONS			
		MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	MANUFACTURER	MODEL NUMBER	COLD WATER	HOT WATER	SANITARY SEWER
	SH-1 SHOWER VALVE AND HEAD PROVIDE WITH DRAIN. VALVE TO BE ANTI-SCALD PER NORTH CAROLINA BUILDING CODE. PROVIDE WITH SEAT, GRAB BARS, AND CURTAIN OR DOOR AS REQUIRED PER ADA REQUIREMENTS.	AMERICAN STANDARD	A8009D-FOO							2"
	U-1 URINAL VALVE CARRIER URINAL SHALL BE MADE OF VITREOUS CHINA WITH A WHITE FINISH AND 3/4" TOP SPUD. EXPOSED CHROME PLATED FLUSH VALVE WITH 3/4" CHROME PLATED SPUD COUPLING AND FLANGE. MOUNTING HEIGHT TO BE ADA COMPLIANT.	KOHLER	K-506-ET	SLOAN	SUT009	AMERICAN STANDARD	454U32			2"
	WC-1 WATER CLOSET SEAT VALVE TOILET SHALL BE MADE OF VITREOUS CHINA WITH A WHITE FINISH AND A 1/2" ROUGH-IN AND 1 1/2" TOP SPUD. SEAT SHALL BE EXTRA HEAVY WEIGHT SOLID PLASTIC WITH OPEN FRONT LESS COVER FOR ELONGATED BOWL. EXPOSED CHROME PLATED FLUSH VALVE WITH 1 1/2" CHROME PLATED SPUD COUPLING AND FLANGE.	KOHLER	K-96059-O	SLOAN	ST-2009	AMERICAN STANDARD	223406			4"
	WC-2 WATER CLOSET SEAT VALVE TOILET SHALL BE MADE OF VITREOUS CHINA WITH A WHITE FINISH AND A 1/2" ROUGH-IN AND 1 1/2" TOP SPUD. SEAT SHALL BE EXTRA HEAVY WEIGHT SOLID PLASTIC WITH OPEN FRONT LESS COVER FOR ELONGATED BOWL. EXPOSED CHROME PLATED FLUSH VALVE WITH 1 1/2" CHROME PLATED SPUD COUPLING AND FLANGE. THE FLUSH VALVE MECHANISM SHALL BE PLACED ON THE WIDE SIDE OF THE STALL.	KOHLER	K-96057-O	SLOAN	ST-2029	AMERICAN STANDARD	230500			4"
	WM-1 WASHING MACHINE BOX PLASTIC WASHING MACHINE BOX WITH 1/4 TURN BRASS BALL VALVES - COPPER SWEAT AND DRAIN. MOUNT 42" ABOVE FINISHED FLOOR.	OATEY CO.	3806	GUY GRAY		SOLIX CHIEF		1/2"	1/2"	2"































PLUMBING SCHEDULE NOTES AND LEGEND:

- THE PLUMBING CONTRACTOR MAY SUBSTITUTE FIXTURES WITH OWNERS' APPROVAL.
  - SUBMIT CUT SHEETS FOR ALL PROPOSED FIXTURES TO ARCHITECT PRIOR TO BIDDING.
  - PROVIDE VACUUM BREAKER ON ALL EQUIPMENT REQUIRING PLUMBING.
  - REFER TO MANUFACTURERS WEB SITE FOR CUT SHEETS AND DATA ON THE FIXTURES AND APPURTENANCES USED IN THIS SCHEDULE.
- ADA COMPLIANT  
ELECTRICAL POWER  
GAS FIRED

PLUMBING GENERAL NOTES

- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE STATE CODE, ALL LOCAL AND OTHER APPLICABLE CODES.
- ANY PERMITS AND INSPECTION FEES SHALL BE SECURED AND PAID FOR BY THE PLUMBING CONTRACTOR.
- ALL WORK SHALL BE PERFORMED BY EXPERIENCED AND SKILLED CRAFTSMAN. THE PLUMBING CONTRACTOR SHALL COORDINATE ALL OF HIS WORK WITH ALL OTHER CONTRACTORS.
- THE PLUMBING PLANS AND SPECIFICATIONS SHALL BE THOROUGHLY REVIEWED PRIOR TO PURCHASING MATERIALS AND INSTALLATION. ALL DISCREPANCIES OR INTERFERENCE'S SHALL BE BROUGHT TO THE ENGINEERS ATTENTION.
- THESE PLANS ARE DIAGRAMMATIC AND MAY NOT SHOW MINOR DETAILS AND LOCATIONS. FOR DIMENSIONS, REFER TO THE ARCHITECTURAL PLANS.
- THE PLUMBING CONTRACTOR SHALL PROVIDE ALL OPENINGS REQUIRED FOR THE PLUMBING WORK. THE PATCHING SHALL BE BY THE PLUMBING CONTRACTOR AND FINISHING BY GENERAL CONTRACTOR.
- ALL PIPE, FITTINGS, FIXTURES, AND SOLDER TO BE LEAD FREE.
- WATER PIPING BELOW GRADE SHALL BE TYPE 1" COPPER IN JOINTS BELOW GRADE AND ABOVE GRADE TYPE 1" COPPER. SUPPORTED AS REQUIRED AND SHALL BE HYDROSTATICALLY TESTED FOR ONE HOUR AT 80 PSI. TEST TO COMPLY WITH ALL EPA STANDARDS. THE ENTIRE WATER DISTRIBUTION SYSTEM SHALL BE DISINFECTED PRIOR TO PLACING IN SERVICE.
- WATER PIPING LOCATED ABOVE CEILING AND IN EXTERIOR WALLS SHALL BE ROUTED ON HEATED SIDE OF CEILING INSULATION (UNDERSIDE) AND WALL INSULATION (INSIDE).
- ALL COLD AND HOT WATER PIPING SHALL BE INSULATED. INSULATE WASTE PIPING AS DESIGNATED ON PLUMBING DRAWINGS. INSULATION SHALL BE 1" FIBERGLASS. EXPOSED PIPING TO BE WRAPPED WITH ALUMINUM JACKET.
- WATER SHUT - OFF VALVES ABOVE FINISHED CEILING ARE TO BE FREE FROM OBSTRUCTIONS SUCH AS DUCTWORK, LIGHTS, WIRING AND OTHER PIPING SO AS TO PROVIDE EASY ACCESS. MOUNT NO MORE THAN 2'-0" ABOVE FINISHED CEILING.
- PLUMBING CONTRACTOR SHALL PROVIDE A DIELECTRIC UNION WHEN CONNECTING DISSIMILAR MATERIAL.
- WATER HEATERS SHALL HAVE AND EFFICIENCY MEETING REQUIREMENTS OF THE NORTH CAROLINA BUILDING CODE.
- THE PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ELECTRICAL AND CONTROL CONNECTIONS TO THE EQUIPMENT FURNISHED UNDER HIS CONTRACT.
- SANITARY SEWER AND VENT PIPING SHALL BE SCHEDULE 40 PVC. CELLULAR CORE (FOAM CORE) IS NOT ALLOWED. SANITARY SEWER AND VENT PIPING SHALL BE GAS AND AIR TIGHT.
- THE PLUMBING CONTRACTOR SHALL COORDINATE ALL WORK WITH OTHER TRADES PRIOR TO INSTALLATION OF ANY WORK.
- THE PLUMBING CONTRACTOR SHALL REVIEW ALL UTILITY SITE PLANS FOR WORK BY OTHERS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE HIS WORK WITH WORK BY OTHERS AND AVOID ALL CONFLICTS.
- LOCATIONS OF UTILITIES (WASTE AND WATER PIPING, ETC.) PROVIDED BY OTHERS, THAT ARE TO BE CONNECTED TO ARE ASSUMED. IT SHALL BE THE RESPONSIBILITY OF THE PLUMBING CONTRACTOR TO VERIFY THESE LOCATIONS AND MAKE FINAL CONNECTIONS AS REQUIRED.
- VERIFY THE LOCATION OF ALL EQUIPMENT SUPPLIED BY OTHERS.
- PROVIDE VACUUM BREAKERS ON ALL EQUIPMENT DIRECTLY CONNECTED TO THE WATER SYSTEM.
- ALL VENT PIPING THROUGH THE ROOF SHALL BE A MINIMUM OF 5'-0" FROM ALL MAKE-UP AIR INLETS OR A MINIMUM OF 2'-0" ABOVE THE TOP OF ALL MAKE-UP AIR INLETS. VENTS THROUGH ROOF ARE TO BE ON REAR OF BUILDING.
- SEE ARCHITECTURAL DRAWINGS FOR PLUMBING MINIMUM FACILITY CALCULATIONS.
- ALL INDIRECT WASTE IS TO BE PROVIDED WITH AN AIR GAP 2 TIMES THE SIZE OF THE WASTE INLET.
- THE PLUMBING CONTRACTOR SHALL VERIFY BUILDING FLOOR ELEVATION IS ABOVE MANHOLE RIM ELEVATION OR PROVIDE A BACKWATER VALVE AS REQUIRED.
- THE PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR MINOR DEMOLITION AT NO COST TO THE OWNER.
- THE PLUMBING CONTRACTOR SHALL PROVIDE THE ENGINEER WITH A SET OF AS-BUILT DRAWINGS UPON COMPLETION OF PROJECT.

PLUMBING SYMBOL LEGEND

SYMBOL	DESCRIPTION
	COLD WATER PIPING
	WATER PIPING DIRECTION OF FLOW
	EXISTING COLD WATER PIPING
	EXISTING COLD WATER PIPING TO BE REMOVED
	COLD WATER PIPING BELOW FINISHED FLOOR
	HOT WATER PIPING
	EXISTING HOT WATER PIPING
	EXISTING HOT WATER PIPING TO BE REMOVED
	HOT WATER RETURN PIPING
	EXISTING HOT WATER RETURN PIPING
	BALL VALVE
	WATER PIPING TURNED DOWN
	WATER PIPING TURNED UP
	PIPING SIDE CONNECTION
	TRAP PRIMER
	SANITARY SEWER / WASTE PIPING
	SANITARY SEWER / WASTE PIPING DIRECTION OF FLOW
	EXISTING SANITARY SEWER / WASTE PIPING
	VENT PIPING
	VENT PIPE UP
	NON FREEZE WALL HYDRANT
	HOSE BIBB
	PLUMBING FIXTURE PROVIDED AND INSTALLED BY PLUMBING CONTRACTOR
	PLUMBING FIXTURE PROVIDED BY OTHERS AND INSTALLED BY PLUMBING CONTRACTOR
	FLOOR CLEANOUT
	WALL CLEANOUT
	FLOOR DRAIN
	CONNECT TO EXISTING
	ELECTRICAL EQUIPMENT BY ELECTRICAL CONTRACTOR.
	ROUTE PIPING TO AVOID.

PLUMBING LOAD SUMMARY

	SANITARY SEWER DEMAND FU	WATER DEMAND FU	WATER DEMAND GPM
REMOVED	102.0	171.0	84.0
ADDED	123.0	25.0	94.0

GENERAL NOTE:  
Prior to construction start, Contractor shall verify & be responsible for all dimensions.

Revisions  
△

Date	Project No.
Drawn By	Sheet No.
Checked By	
Sheet Title	

PLUMBING DEMOLITION NOTES

- EXISTING PLUMBING FIXTURE TO REMAIN, NO WORK.
- CONNECT EXISTING HOT/COLD WATER STUB-INS TO NEW LAVATORY, FIELD VERIFY EXACT LOCATION.
- CONNECT EXISTING HOT/COLD WATER STUB-INS TO NEW URINAL, FIELD VERIFY EXACT LOCATION.
- CONNECT EXISTING HOT/COLD WATER STUB-INS TO NEW WATER CLOSET, FIELD VERIFY EXACT LOCATION.
- CONNECT EXISTING HOT/COLD WATER STUB-INS TO NEW SINK, FIELD VERIFY EXACT LOCATION.
- CONNECT TO EXISTING HOT WATER IN THIS AREA AS REQUIRED, FIELD VERIFY EXACT LOCATION.
- CONNECT TO EXISTING COLD WATER IN THIS AREA AS REQUIRED, FIELD VERIFY EXACT LOCATION.
- CONNECT EXISTING HOT/COLD WATER STUB-INS TO NEW LAVATORY IN WALL AS REQUIRED.
- REMOVE A SECTION OF EXISTING COLD WATER PIPING IN THE RISE FOR CONNECTION TO NEW BACK FLOW PREVENTER, SEE WATER RISER WP22 FOR DETAILED ROUTING.

NO WORK PLUMBING WORK  
THIS AREA. FOR REFERENCE ONLY

2 PLUMBING WATER PLAN - AREA B  
P12 SCALE: 1/8" = 1'-0"




1 PLUMBING WATER PLAN - AREA A  
P12 SCALE: 1/8" = 1'-0"





PLUMBING DEMOLITION NOTES

- EXISTING VENT PIPE UP, NO WORK.
- CONNECT TO EXISTING VENT IN THIS AREA. FIELD VERIFY EXACT LOCATION.

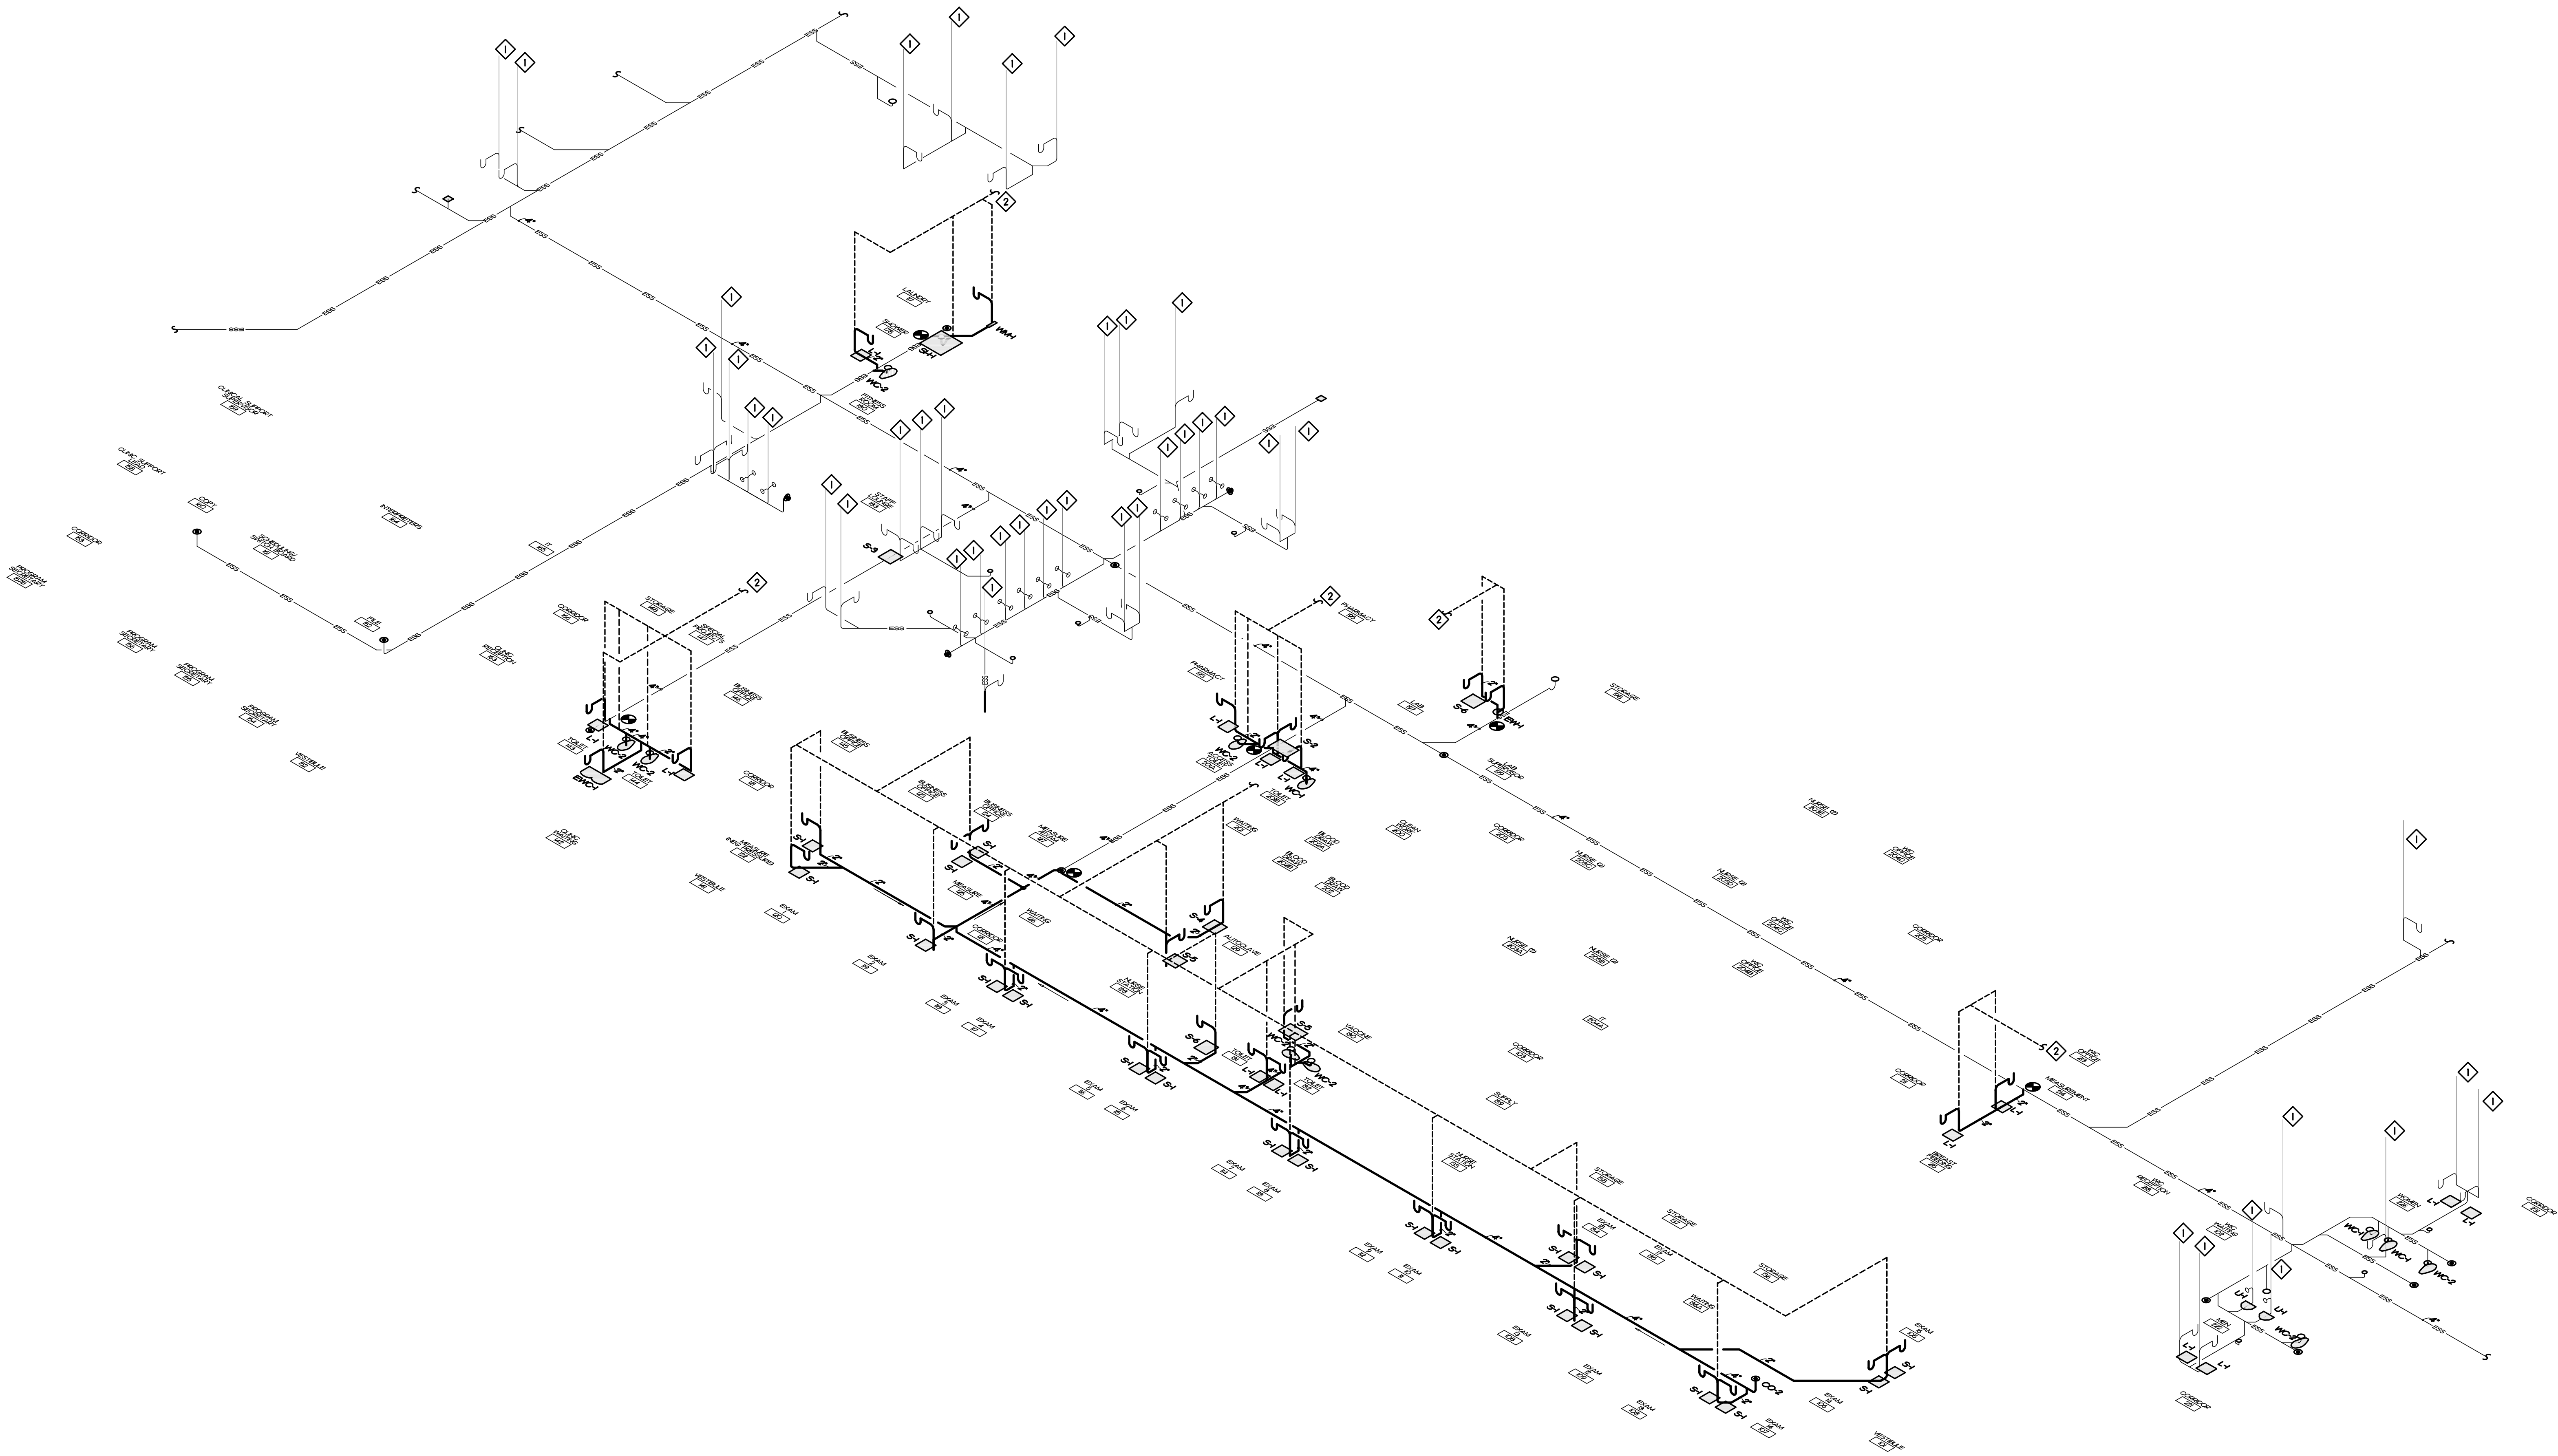


1 WASTE RISER  
P2.1 SCALE: NOT TO SCALE

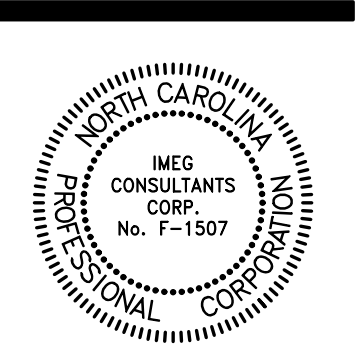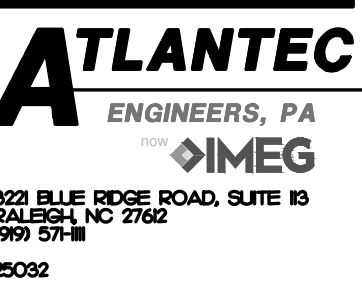

GENERAL NOTE: Prior to construction start, Contractor shall verify & be responsible for all Dimensions.	
Revisions △	
Date	Project No.
Drawn By	Sheet No.
Checked By	Sheet Title


Copyright © 2025 Oakley Collier Architects. These drawings are of the property of the Architect for use under his supervision. No reproduction or other use is allowed without permission.

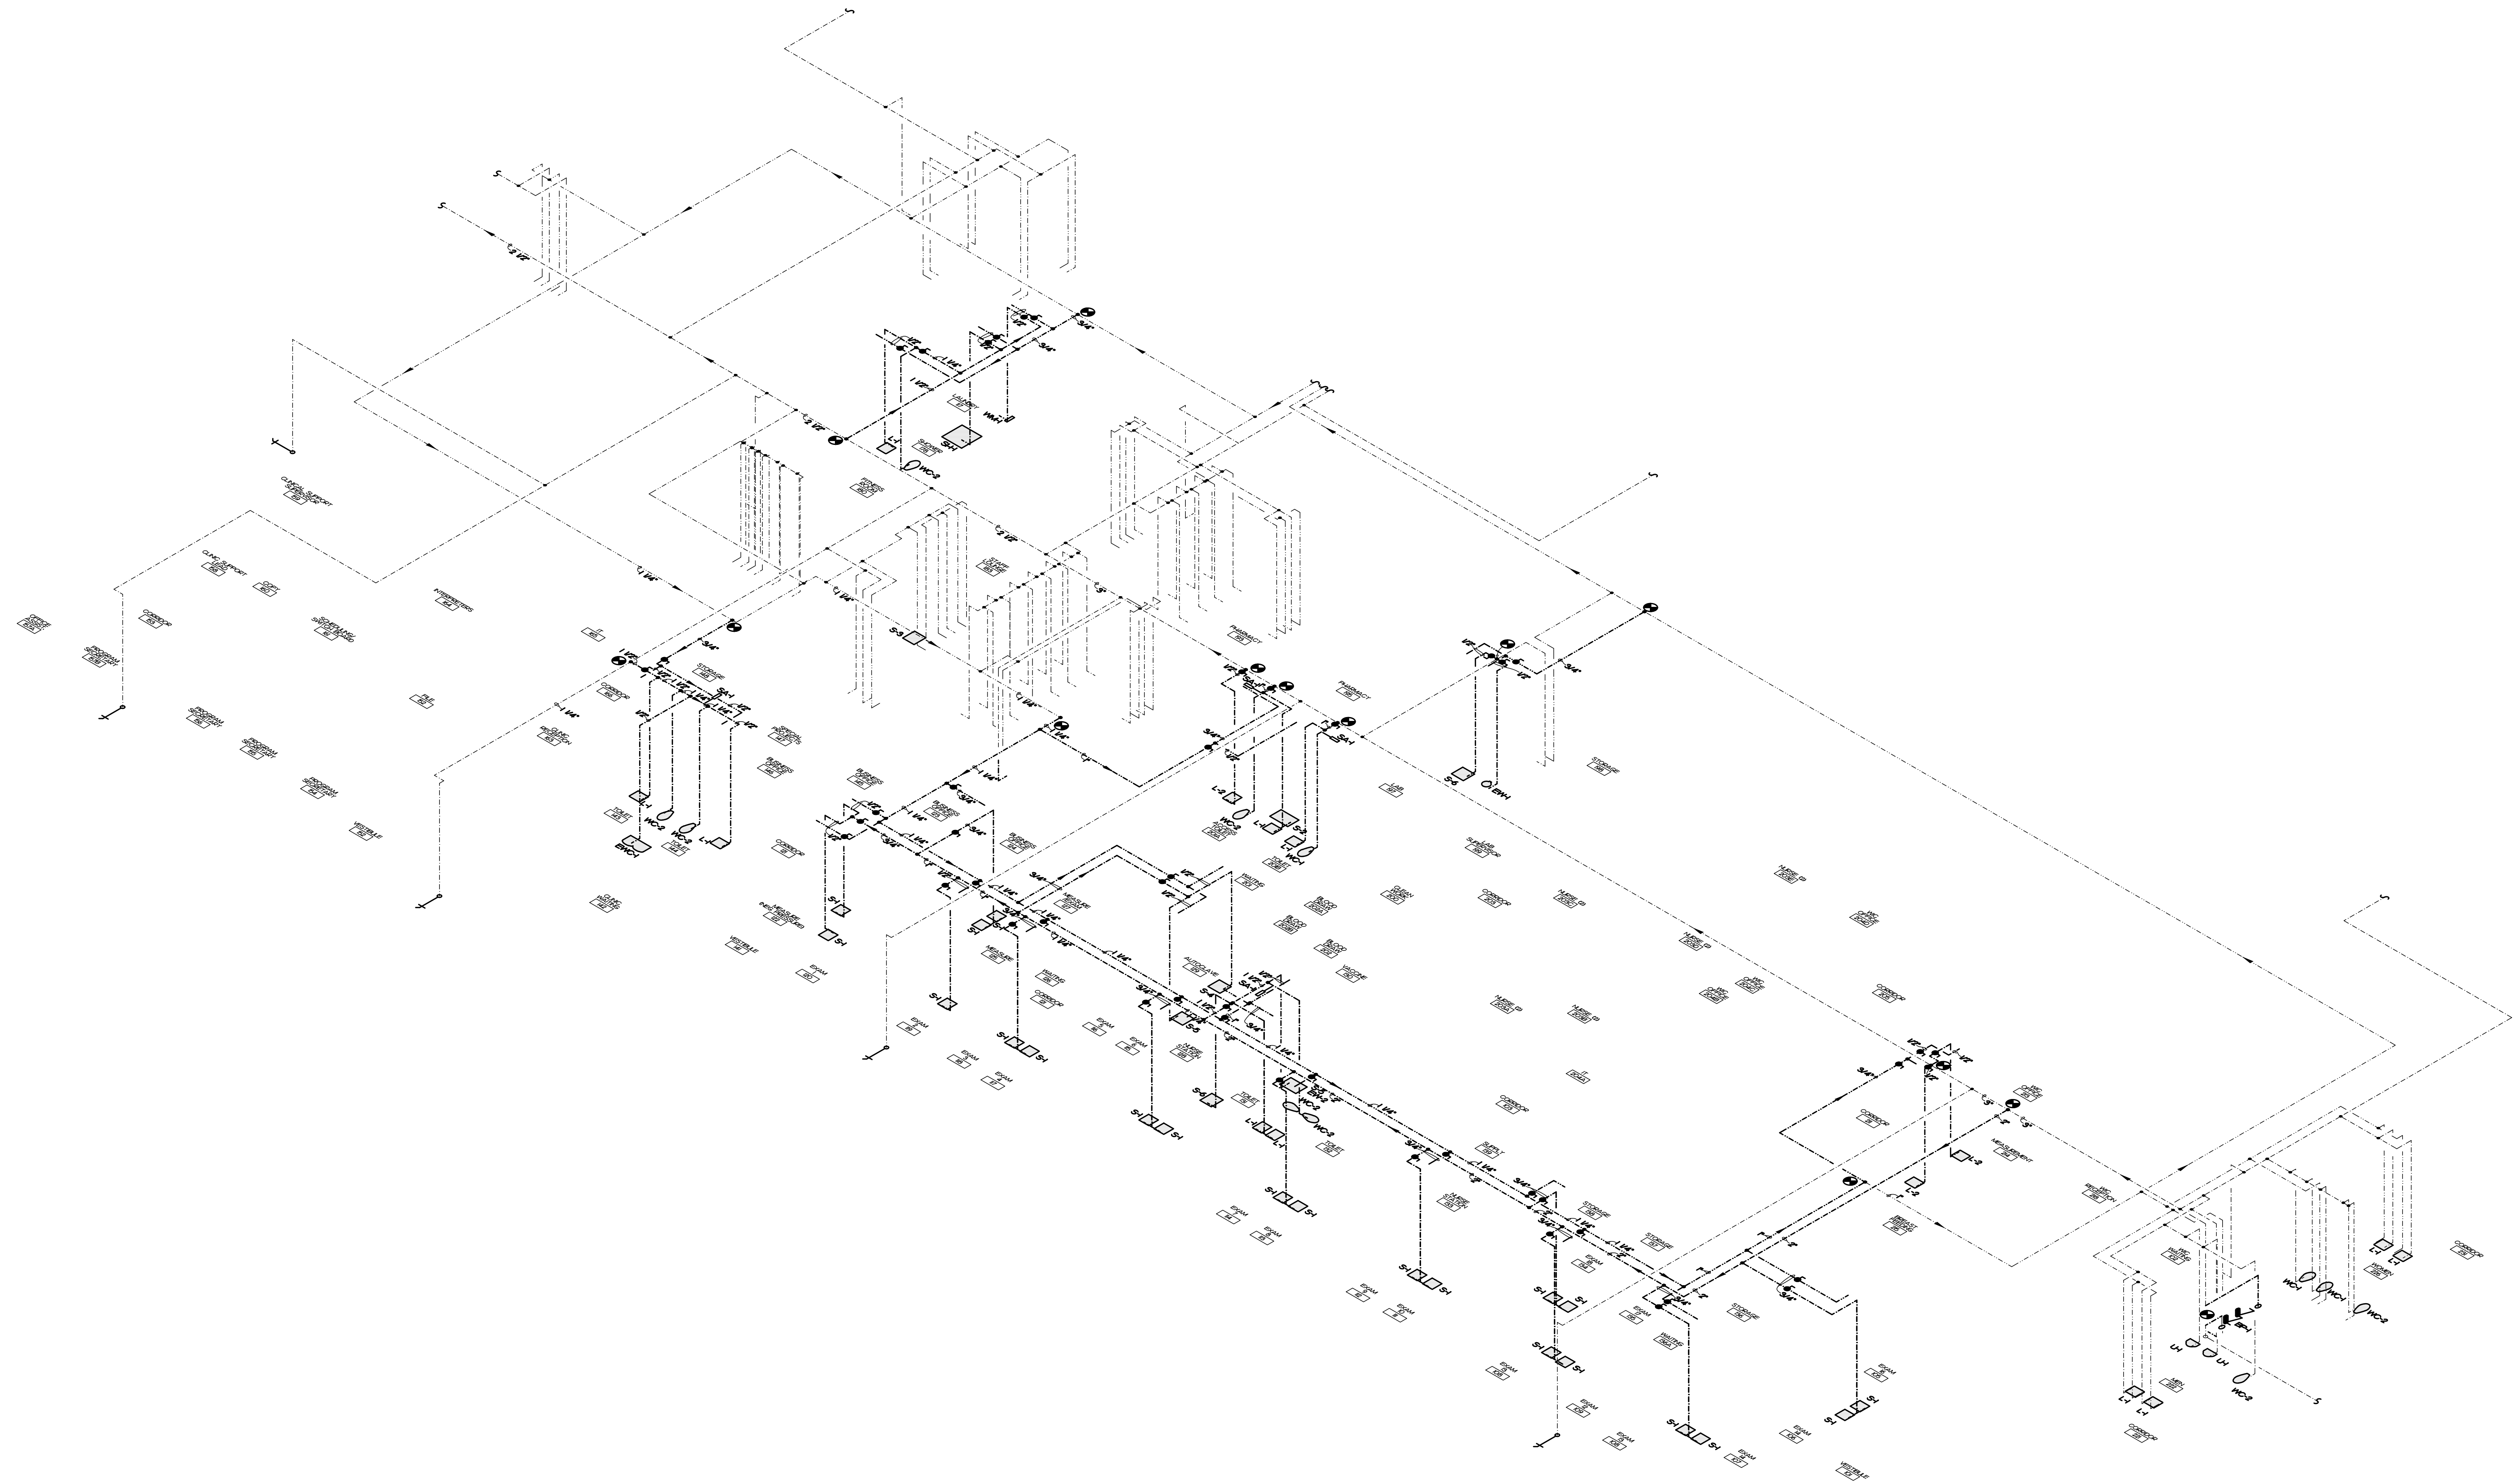

**1 WATER RISER**  
**P2.2 SCALE: NOT TO SCALE**



**ATLANTEC**  
ENGINEERS, PA  
IMEG  
323 BLUE DOGE ROAD, SUITE 10  
DALLAS, TX 75222  
972.521.1111  
25082



GENERAL NOTE:  
Prior to construction  
start, Contractor shall  
verify & be responsible  
for all Dimensions.

Revisions △	
Date	Project No.
Drawn By	Sheet No.
Checked By	Sheet Title