



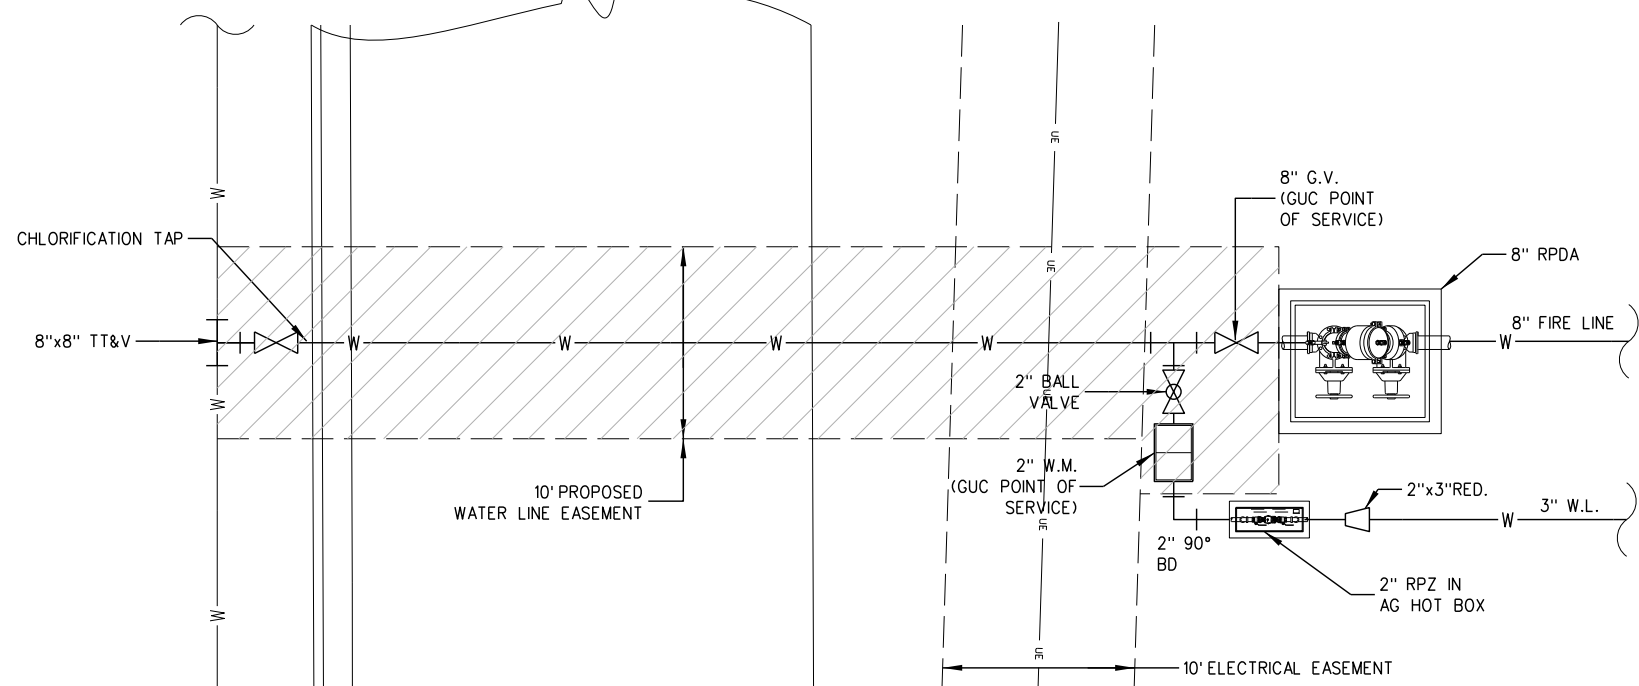

NOTES:

1. TEMPORARY CHLORINATION TAPS AND BACTERIOLOGICAL SAMPLE POINTS SHALL BE CONSTRUCTED OF THE SAME MATERIALS AS ONE INCH WATER SERVICES TEMPORARY APPURTENANCES SHALL BE INSTALLED TO EACH CURB STOP LOCATED 36 FEET OR MORE ABOVE FINISH GRADE. PRIOR TO REMOVAL OF FINAL BACTERIOLOGICAL SAMPLES THE TUBING AND ANGLE BALL VALVE SHALL BE REMOVED THE CORPORATION STOP CLOSED AND THE CAP PLACED ON THE CORPORATION STOP.
2. THIS PROJECT WILL REQUIRE THE SUBMITTAL OF A CONSTRUCTION PLAN AND SHOP DRAWINGS FOR APPROVAL AND AN EXECUTED HOOK HARMLESS AGREEMENT PRIOR TO SCHEDULING A REQUIRED PRE-CONSTRUCTION MEETING. NO PRE-CONSTRUCTION MEETING OR CONFERENCE NO FINISH WORK CAN TAKE PLACE WITHOUT A PRE-CONSTRUCTION MEETING.
3. NO VALVES SHALL BE LOCATED IN THE CURB AND GUTTER.

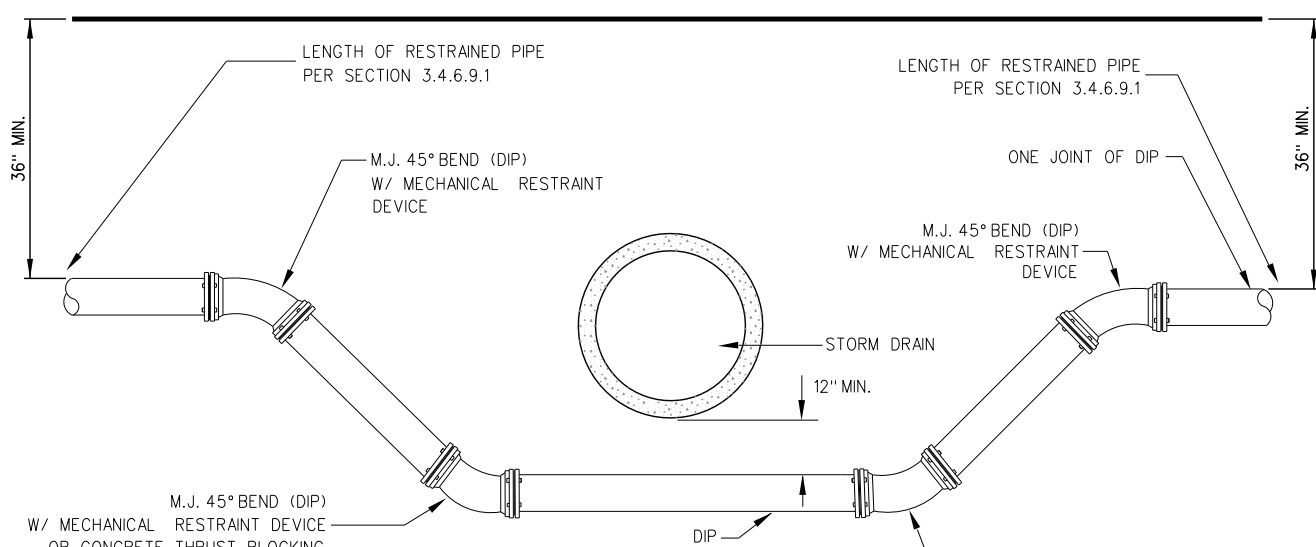

NOTES:

PLACE CONC. BLOCKING SUCH THAT IT WILL NOT INTERFERE WITH REMOVAL OF BOLTS.

PIPE DIAMETER GREATER THAN 12" SEE GUC ENGINEERING DEPT.

PIPE LENGTHS SHALL BE AS REQUIRED TO CONSTRUCT CROSSING.

W/ MECHANICAL RESTRAINT DEVID OR CONCRETE THRUST BLOCKING

WATER MAIN AND STORM DRAIN CROSSING

SCALE: None

